



Paroc Panel System:	Fire	Detail No.:	FI-I-304
Type:	Fire partition detail	Scale:	1:5
Subject:	Fixing to column and fire protection of fasteners Horizontal installation	Revision:	A
		Date:	02/2012
		Revision Date:	08.12.2020
		Signature:	KjN
		Revision Signature:	JeN

Notice: Principle Master Detail

Project specific changes on designer's responsibility

Classification: Copyright Paroc Panel System 2019-07-01

Panel span (m)	Thickness of the stone wool protection for fasteners/profiles				
	EI 60	EI 90	EI 120	EI 180	EI 240
≤ 6 m	-	-	30 mm	40 mm	50 mm
> 6 m	-	30 mm	30 mm	40 mm	50 mm

#### Attention!


In fire partition walls/ceilings use always screws and rivets of steel!

Information about joint sealants in internal walls can be found in details FI-I-105 and FI-I-106

#### Wall classification:

The fire partitioning class according to the CE-approval for Paroc panel!

Classification must always be compared with national certificates and requirements!

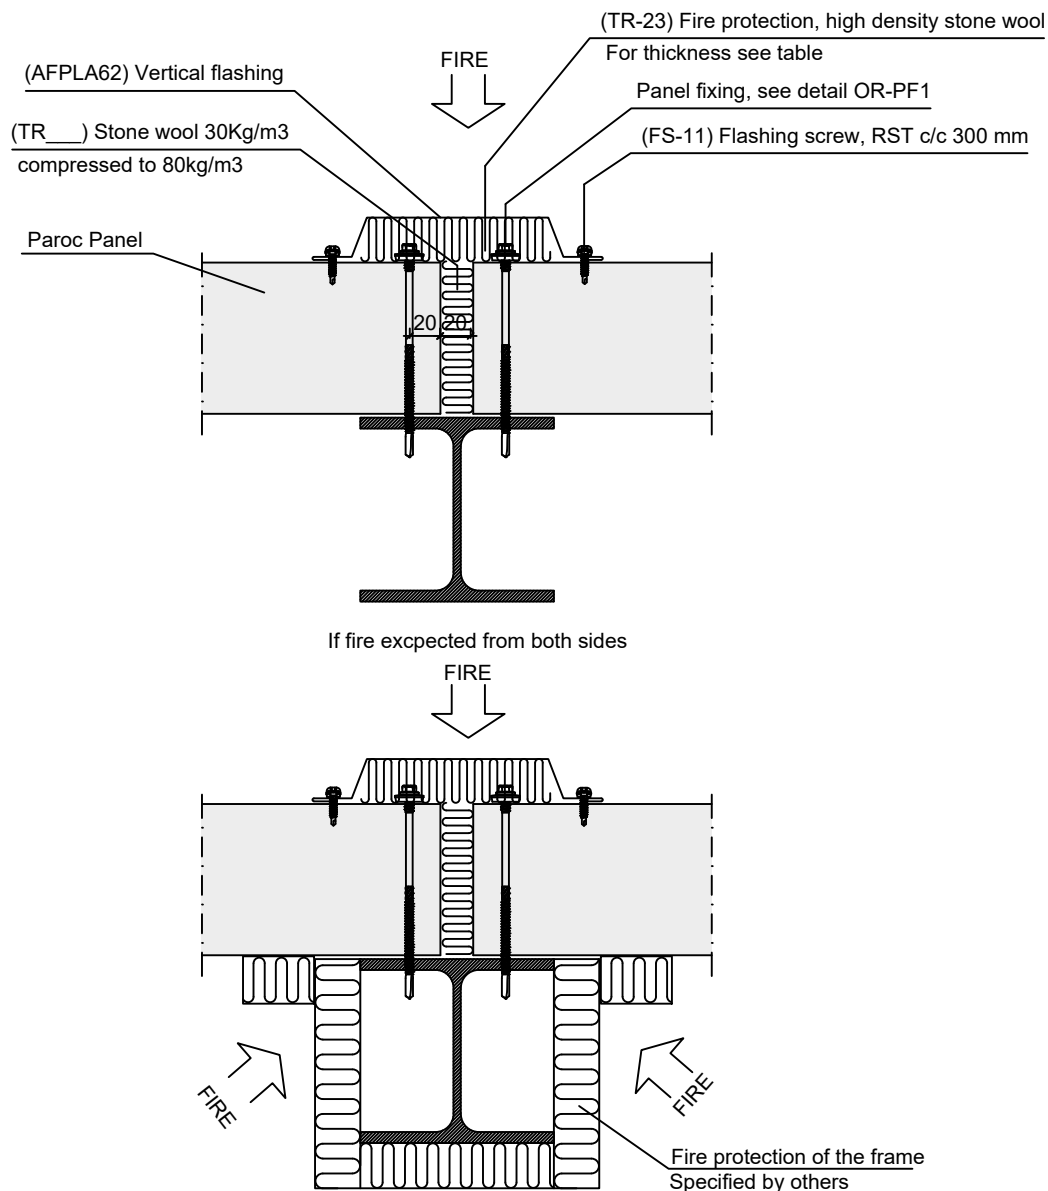

[X] Supplier Paroc Panel System